



# A/C SYSTEM JOBSITE INFORMATION SHEET



# A/C SYSTEM JOBSITE INFORM

## OWNER:

NAME \_\_\_\_\_

STREET \_\_\_\_\_

CITY \_\_\_\_\_ ZIP \_\_\_\_\_

STATE/PROVINCE \_\_\_\_\_ PHONE \_\_\_\_\_

CONTACT \_\_\_\_\_

## DATE REQUESTED:

\_\_\_\_\_

## REQUESTOR:

\_\_\_\_\_

## SERVICING CONTRACTOR:

NAME \_\_\_\_\_

STREET \_\_\_\_\_

CITY \_\_\_\_\_ ZIP \_\_\_\_\_

STATE/PROVINCE \_\_\_\_\_ PHONE \_\_\_\_\_

CONTACT \_\_\_\_\_

## DISTRIBUTOR:

NAME \_\_\_\_\_

STREET \_\_\_\_\_

CITY \_\_\_\_\_ ZIP \_\_\_\_\_

STATE/PROVINCE \_\_\_\_\_ PHONE \_\_\_\_\_

CONTACT \_\_\_\_\_

## EQUIPMENT DATA:

### OUTDOOR UNIT

MODEL #	SERIAL #	DATE INSTALLED
---------	----------	----------------

### EVAPORATOR

MODEL #	SERIAL #	DATE INSTALLED
---------	----------	----------------

### AIR HANDLER

MODEL #	SERIAL #	DATE INSTALLED
---------	----------	----------------

### FURNACE

MODEL #	SERIAL #	DATE INSTALLED
---------	----------	----------------

## PROBLEM SUMMARY:

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

## CORRECTIVE ACTIONS TAKEN:

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

## ADDITIONAL INFORMATION:

\_\_\_\_\_

\_\_\_\_\_


\_\_\_\_\_

## ACCESSORIES:

<input type="checkbox"/> LOW AMBIENT KIT	<input type="checkbox"/> FILTER-DRIER	<input type="checkbox"/> DISCHARGE LINE MUFFLER	<input type="checkbox"/> ACCUMULATOR
<input type="checkbox"/> COMPRESSOR TIME DELAY	<input type="checkbox"/> COMPRESSOR SOUND ENCLOSURE	<input type="checkbox"/> HOT WATER RECOVERY	<input type="checkbox"/> OTHER:
<input type="checkbox"/> MILD WEATHER KIT	<input type="checkbox"/> OIL SEPARATOR	<input type="checkbox"/> HEAT PUMP MONITOR	_____
<input type="checkbox"/> CRANKCASE HEATER	<input type="checkbox"/> HIGH PRESSURE CUTOUT	<input type="checkbox"/> HOT GAS BYPASS	_____
<input type="checkbox"/> HARD START KIT	<input type="checkbox"/> LOW PRESSURE CUTOUT	<input type="checkbox"/> PUMP DOWN KIT	

# REMEMBER:

1. Circle Metering Device used.
2. Circle YES or NO at drier locations.
3. Circle Service Ports used.
4. Sat. Temp. is pressure converted to Temp.

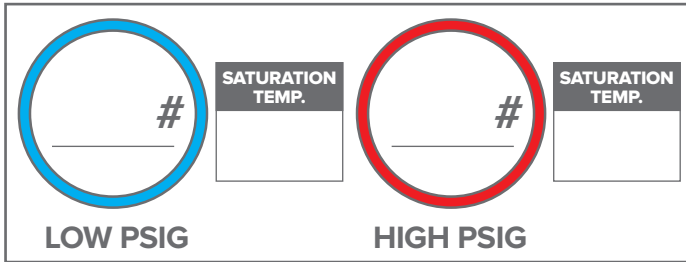

**FORMULA FOR SUPER HEAT**

Vapor Line Temp. \_\_\_\_\_

Minus Sat. Temp. \_\_\_\_\_

---

Equals Super Heat \_\_\_\_\_

**FORMULA FOR SUB COOLING**

Sat. Temp. \_\_\_\_\_

Minus Liquid Line Temp. \_\_\_\_\_


---

Equals Sub Cooling \_\_\_\_\_

**INSIDE TEMP. ENTERING**

DB: \_\_\_\_\_

WB: \_\_\_\_\_

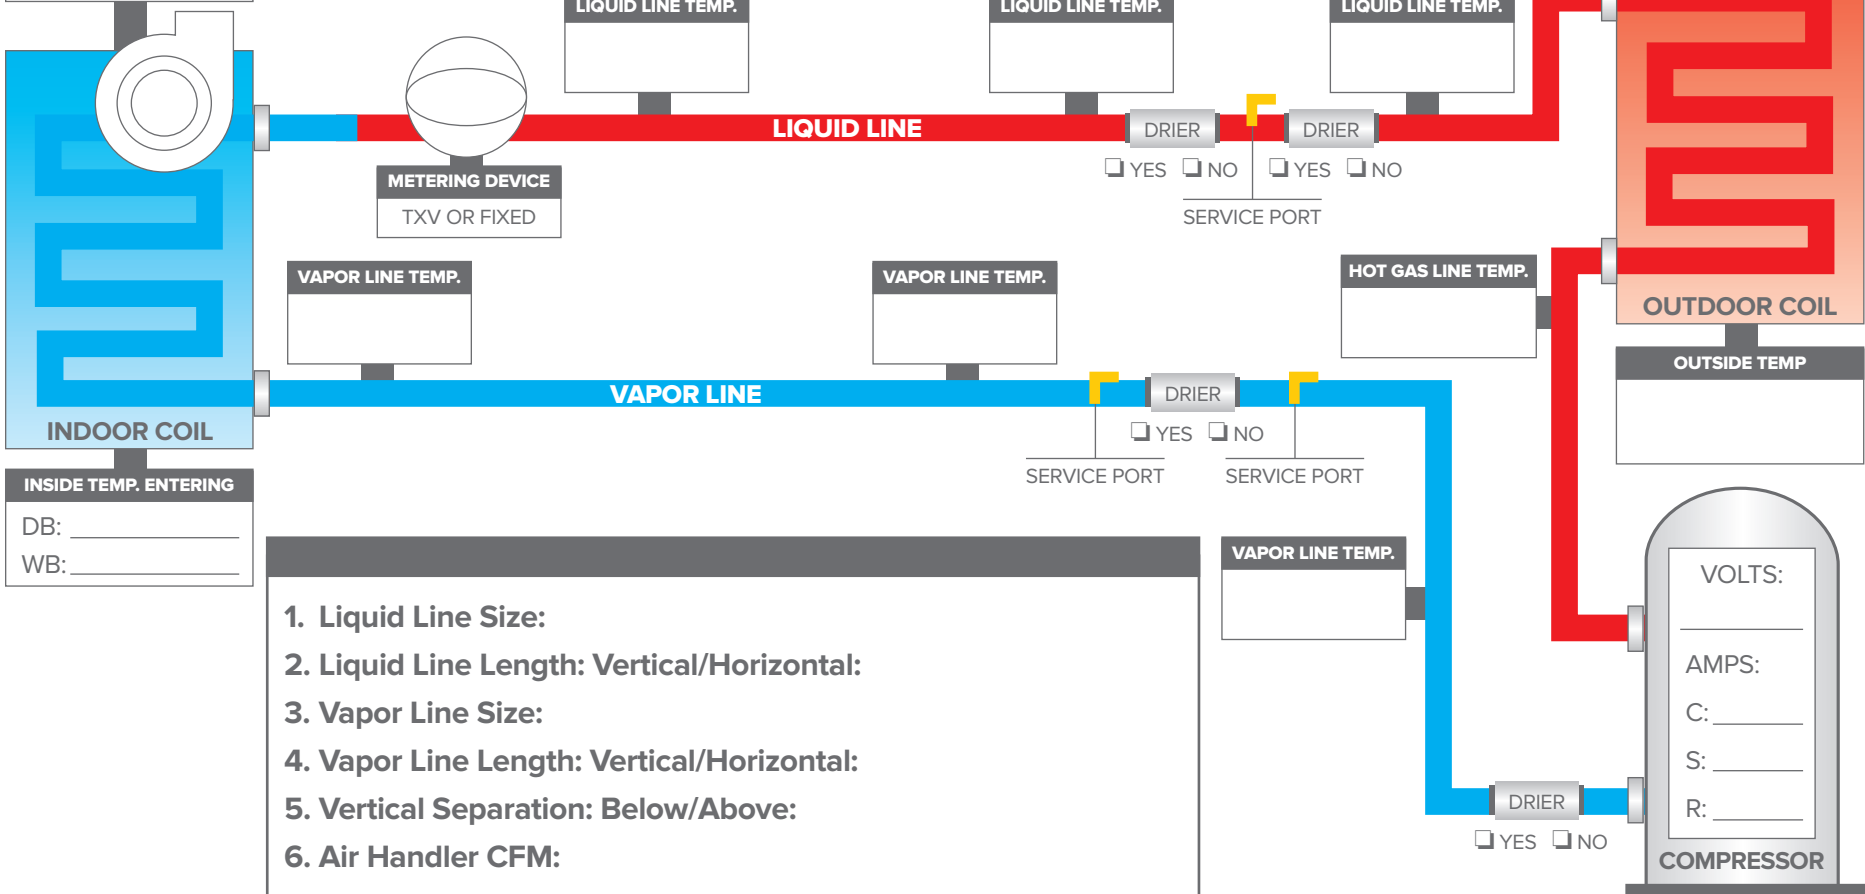

1. Liquid Line Size:
2. Liquid Line Length: Vertical/Horizontal:
3. Vapor Line Size:
4. Vapor Line Length: Vertical/Horizontal:
5. Vertical Separation: Below/Above:
6. Air Handler CFM:



Text your questions to the product experts at these locations • Monday – Friday, 7:00 a.m. – 4:00 p.m.

## CALIFORNIA

### ANAHEIM

(714) 520-6440

### AZUSA

(626) 969-1874

### BAKERSFIELD

(661) 335-7200

### CHATSWORTH

(818) 341-5200

### EL CAJON

(619) 258-9382

### FRESNO

(559) 538-6124

### INDIO

(760) 775-7400

### LANCASTER

(661) 945-6902

### MANTECA

(209) 239-6407

### NEWBURY PARK

(805) 376-3576

### PITTSBURG

(925) 778-1237

### N SACRAMENTO

(916) 924-8661

### S SACRAMENTO

(916) 210-7993

### SAN FERNANDO

(818) 364-9300

### SAN JOSE

(408) 271-1685

## ARIZONA

### GILBERT

(480) 824-4250

### GLENDALE

(602) 246-6982

### MESA

(480) 832-3438

### PRESCOTT

(928) 759-0222

### NE PHOENIX

(480) 308-8200

### NW TUCSON

(520) 670-1100

### S PHOENIX

(602) 438-8945

### SE TUCSON

(520) 290-9851

### W PHOENIX

(623) 474-7200

## NEVADA

### LAS VEGAS

(702) 260-9388

