

FERGUSON HVAC



FERGUSON HVAC

FIELD SERVICE DATA SHEET



Text your questions to the product experts at these locations • Monday – Friday, 7:00 a.m. – 5:00 p.m.**

CALIFORNIA

ANAHEIM (Claudina)
(714) 520-0026

CHICO
(530) 893-2114

HAYWARD
(510) 782-9820

PASO ROBLES
(805) 434-3114

SAN GABRIEL
(626) 458-2432

LAS VEGAS
(702) 260-9388

ANAHEIM (Cerritos)
(714) 520-6440

CULVER CITY
(310) 391-2291

INDIO
(760) 775-7400

PITTSBURG
(925) 778-1237

SAN JOSE
(408) 271-1685

AZUSA
(626) 969-1874

DUBLIN
(925) 828-4875

LANCASTER
(661) 945-6902

POMONA
(909) 517-3810

SAN RAFAEL
(415) 459-3798

BAKERSFIELD
(661) 335-7200

EL CAJON
(619) 258-9382

MANTECA
(209) 239-6407

RIVERSIDE
(951) 784-0506

SANTA CLARITA
(661) 287-3142

CATHEDRAL CITY
(760) 770-6762

FRESNO
(559) 538-6124

NEWBURY PARK
(805) 376-3576

N SACRAMENTO
(916) 924-8661

VAN NUYS
(818) 779-0894

CHATSWORTH
(818) 341-5200

GILROY
(408) 846-6469

ONTARIO
(909) 982-9699

S SACRAMENTO
(916) 210-7993

VICTORVILLE
(760) 241-6284

ARIZONA

GILBERT
(480) 824-4250

MESA
(480) 832-3438

S PHOENIX
(602) 438-8945

PRESCOTT
(928) 759-0222

YUMA
(928) 329-6420

GLENDALE
(602) 246-6982

NE PHOENIX
(480) 308-8200

W PHOENIX
(623) 474-7200

TUCSON
(520) 670-1100

*Hours may vary – please check with your local store.

FERGUSONHVAC.COM

©2021 Ferguson Enterprises, LLC 0621 2372

FIELD SERVICE DATA SHEET

COMPANY NAME:	DATE:
TECHNICIAN:	PHONE:
EMAIL:	
JOB NAME:	START DATE:
ADDRESS:	
PROBLEM:	
ACTIONS TAKEN:	
NOTES:	

COIL / FURNACE:

INDOOR COIL:
 MODEL _____
 SERIAL _____

FURNACE:
 MODEL _____
 SERIAL _____

CONFIGURATION:
 UP _____ DOWN _____
 HZ LEFT _____ HZ RIGHT _____
 CONTROL VOLTAGE _____

LINE VOLTAGE:
 POS-NEUTRAL _____
 POS-GRD _____
 NEUTRAL-GRD _____

GAS PRESSURE:
 INLET UNDER LOAD _____
 OUTLET _____

RETURN TEMP DB _____
 RETURN TEMP WB _____
 SUPPLY TEMP DB _____
 SUPPLY TEMP WB _____
 FAN SPEED _____
 CFM FLASHES _____

STATIC PRES MEASUREMENT:
 P-1 _____ iwc.
 P-2 _____ iwc. **P-1 + P-2 = ESP**
 P-3 _____ iwc.



SUCTION TEMP _____ °
 LIQUID TEMP _____ °

LINE SET:
 SIZE _____
 LENGTH FT _____
 VERTICAL RISE _____
 ELBOWS LR _____
 ELBOWS SR _____
 OUTDOOR ABOVE _____
 OUTDOOR BELOW _____

TXV BULB POSITION:
 2 OR 10 O'CLOCK _____
 4 OR 8 O'CLOCK _____


FILTER: _____ x _____
 QUANTITY _____
FILTER: _____ x _____
 QUANTITY _____

CONDENSER:


REFRIGERANT:
 410A R-22
 FACTORY CHARGE: LBS _____ OZ _____
 ADDED: LBS _____ OZ _____
 REMOVED: LBS _____ OZ _____
 DRIER: YES NO
 DRIER LOCATION: _____
 TEMP DROP ACCESS DRIER: _____

OUTDOOR:
 MODEL _____
 SERIAL _____

AIR TEMP: ENTER _____ EXIT _____
VOLTAGE: BEFORE _____ START _____ RUN _____
AMPS: START _____ RUN _____
RUN CAP: RATING _____ MEASURED _____

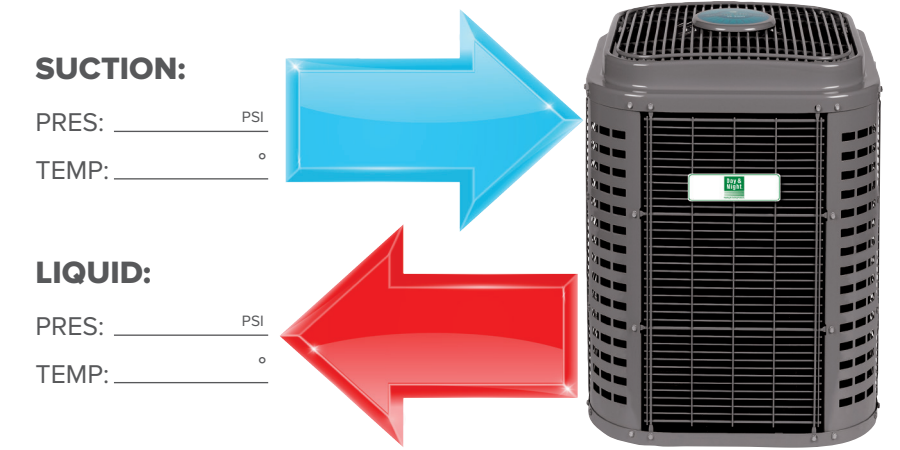

SHADE IN FINAL FURNACE SETTINGS:

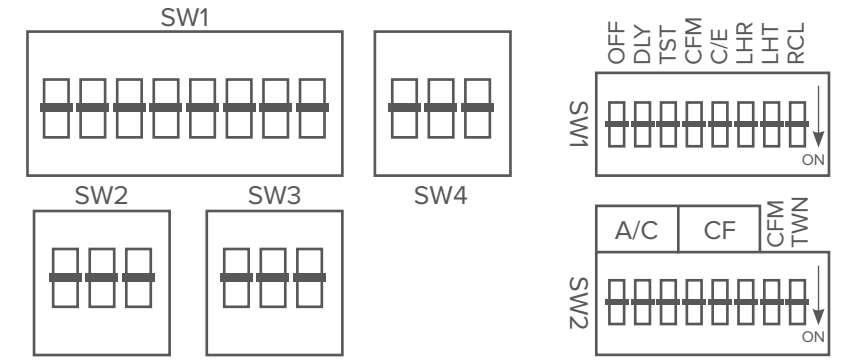

SWITCH POSITION:
 OFF - UP
 ON - DOWN

